




FRONT ELEVATION
SCALE 1:50

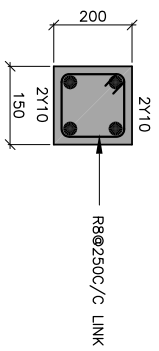


LINTEL BEAM RC DETAILS
SCALE 1:5

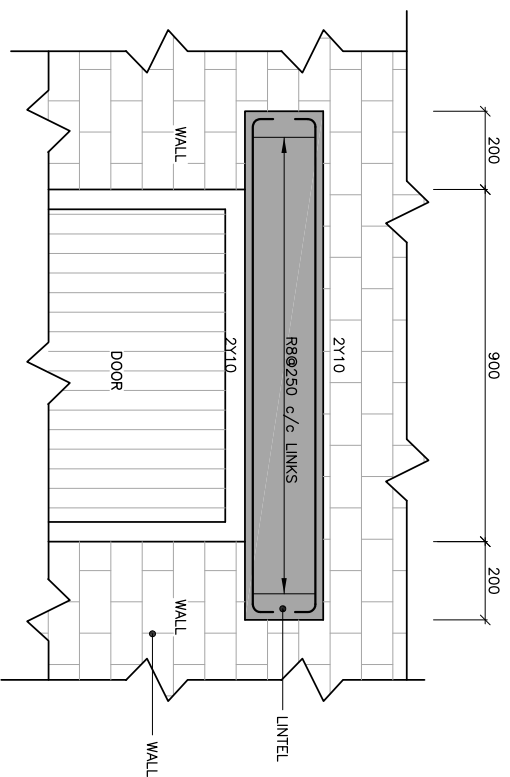

LINTEL BEAM RC DETAILS
SCALE 1:5

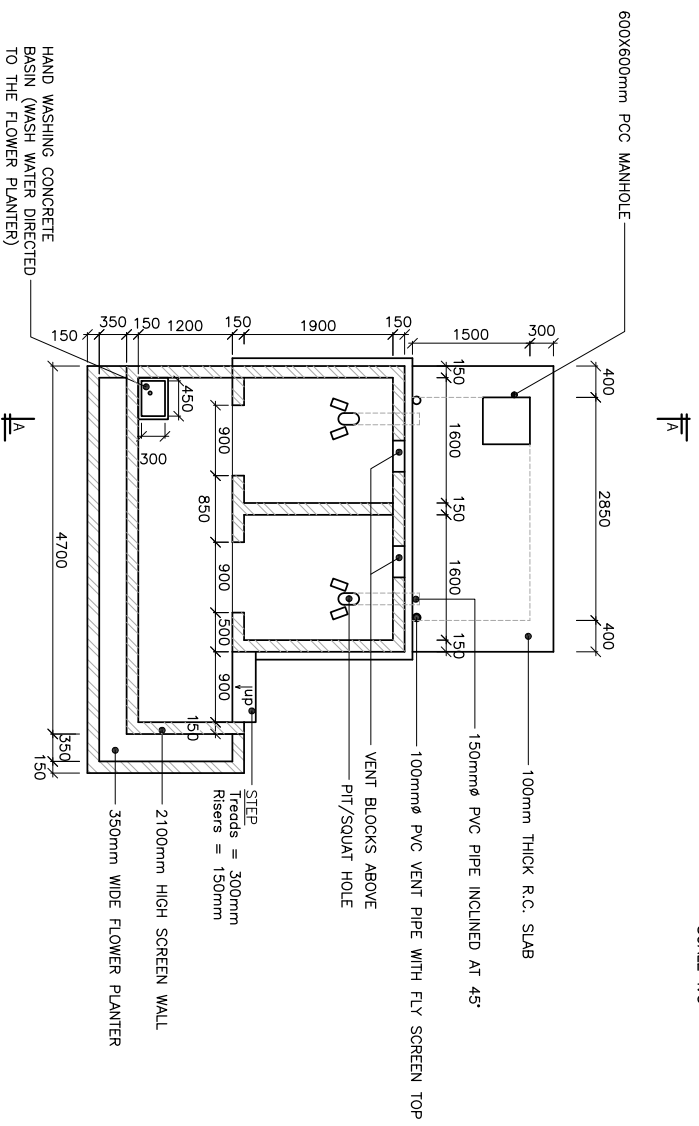

FLOOR PLAN
SCALE 1:50

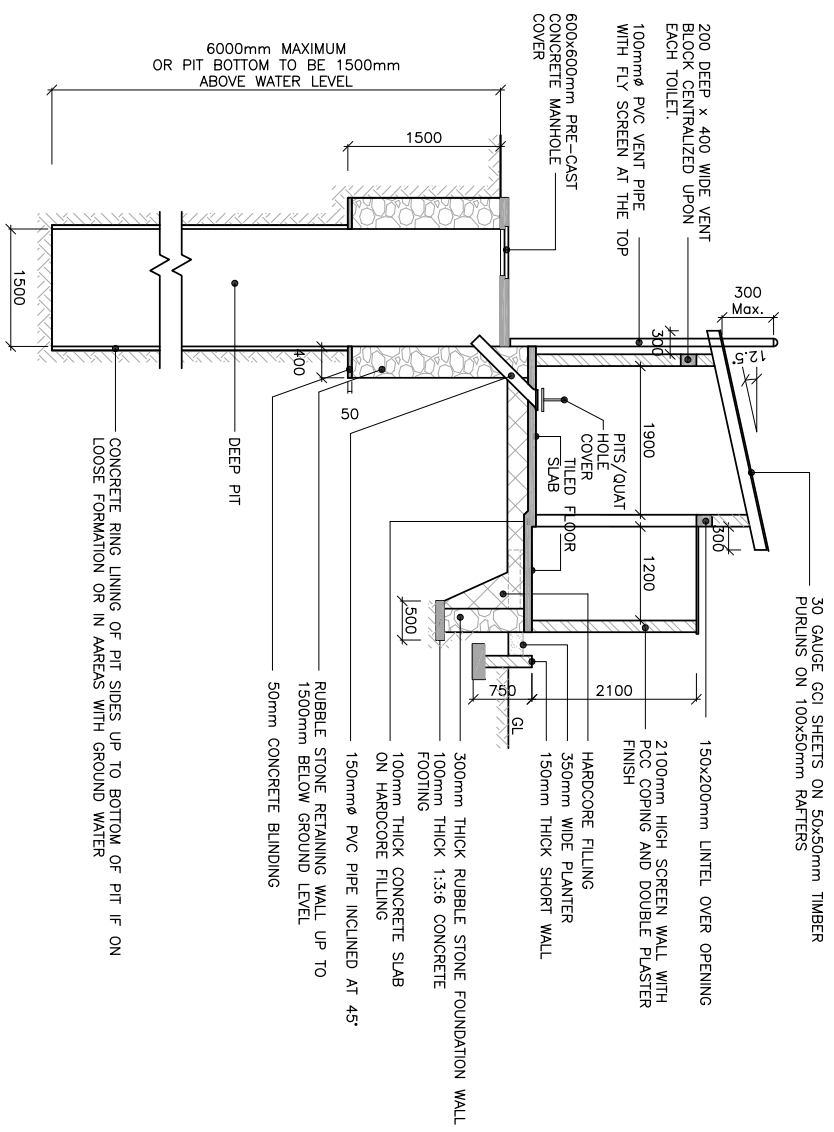

SECTION A-A
SCALE 1:50

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.
2. THE RUBBLE STONE WALLING TO BE JOINED WITH CEMENT/ SAND MORTAR.
3. THE PIT BOTTOM SHOULD BE 1500mm MINIMUM ABOVE WATER LEVEL.
4. ROOF TRUSSES TO BE MADE OF SEASONED CYRUSSE TIMBER OR EQUIVALENT APPROVED CONFORMING TO APPLICABLE LOCAL AND/OR BS STANDARDS.
5. THE SIZE HAS BEEN SIZED BASED ON AN AVERAGE SLUDGE ACCUMULATION RATE OF 60 LITRES/PERSON/YEAR.
6. IN LOOSE FORMATIONS AND/OR AREAS WITH GROUND WATER SUPPLIES THE PIT SHOULD BE LINED TO THE BOTTOM.
7. STRUCTURAL CONCRETE SHALL BE CLASS 25/20 WHILE BLINDING CONCRETE SHALL BE CLASS 15 /20 UNLESS NOTED OTHERWISE.
8. THE FLOOR SLAB SHOULD BE FINISHED WITH 30mm OF CEMENT:SAND (1:4) PAVED STEEL TROWELLED FINISH TO RECEIVE CERAMIC OR EQUIVALENT APPROVED TILES.

Drawing Title

DETAILS
TWIN PIT LATRINE